

NOTICE:







Fire Hydrants currently OUT OF SERVICE due to water tank construction. (Limited Water Capacity)

ALLEGHANY

SEC: 34 T19N R 10E

LAT: 39 28' 00" N


LONG: 120 52' 30" W

-  NORMAL HYDRANT
-  1 1/2" HYDRANT
-  PROPANE OR DIESEL FUEL
-  RESIDENCE
-  UNINHABITED STRUCTURE OR SHED
-  COMMERCIAL BUILDING

**ALL HYDRANTS SHUT OFF DURING
NEW TANK CONSTRUCTION PROJECT
8/22/2018 TO 11/1/2018**

*Available to local resources
for intial attack only*

Sources for Drafting: 

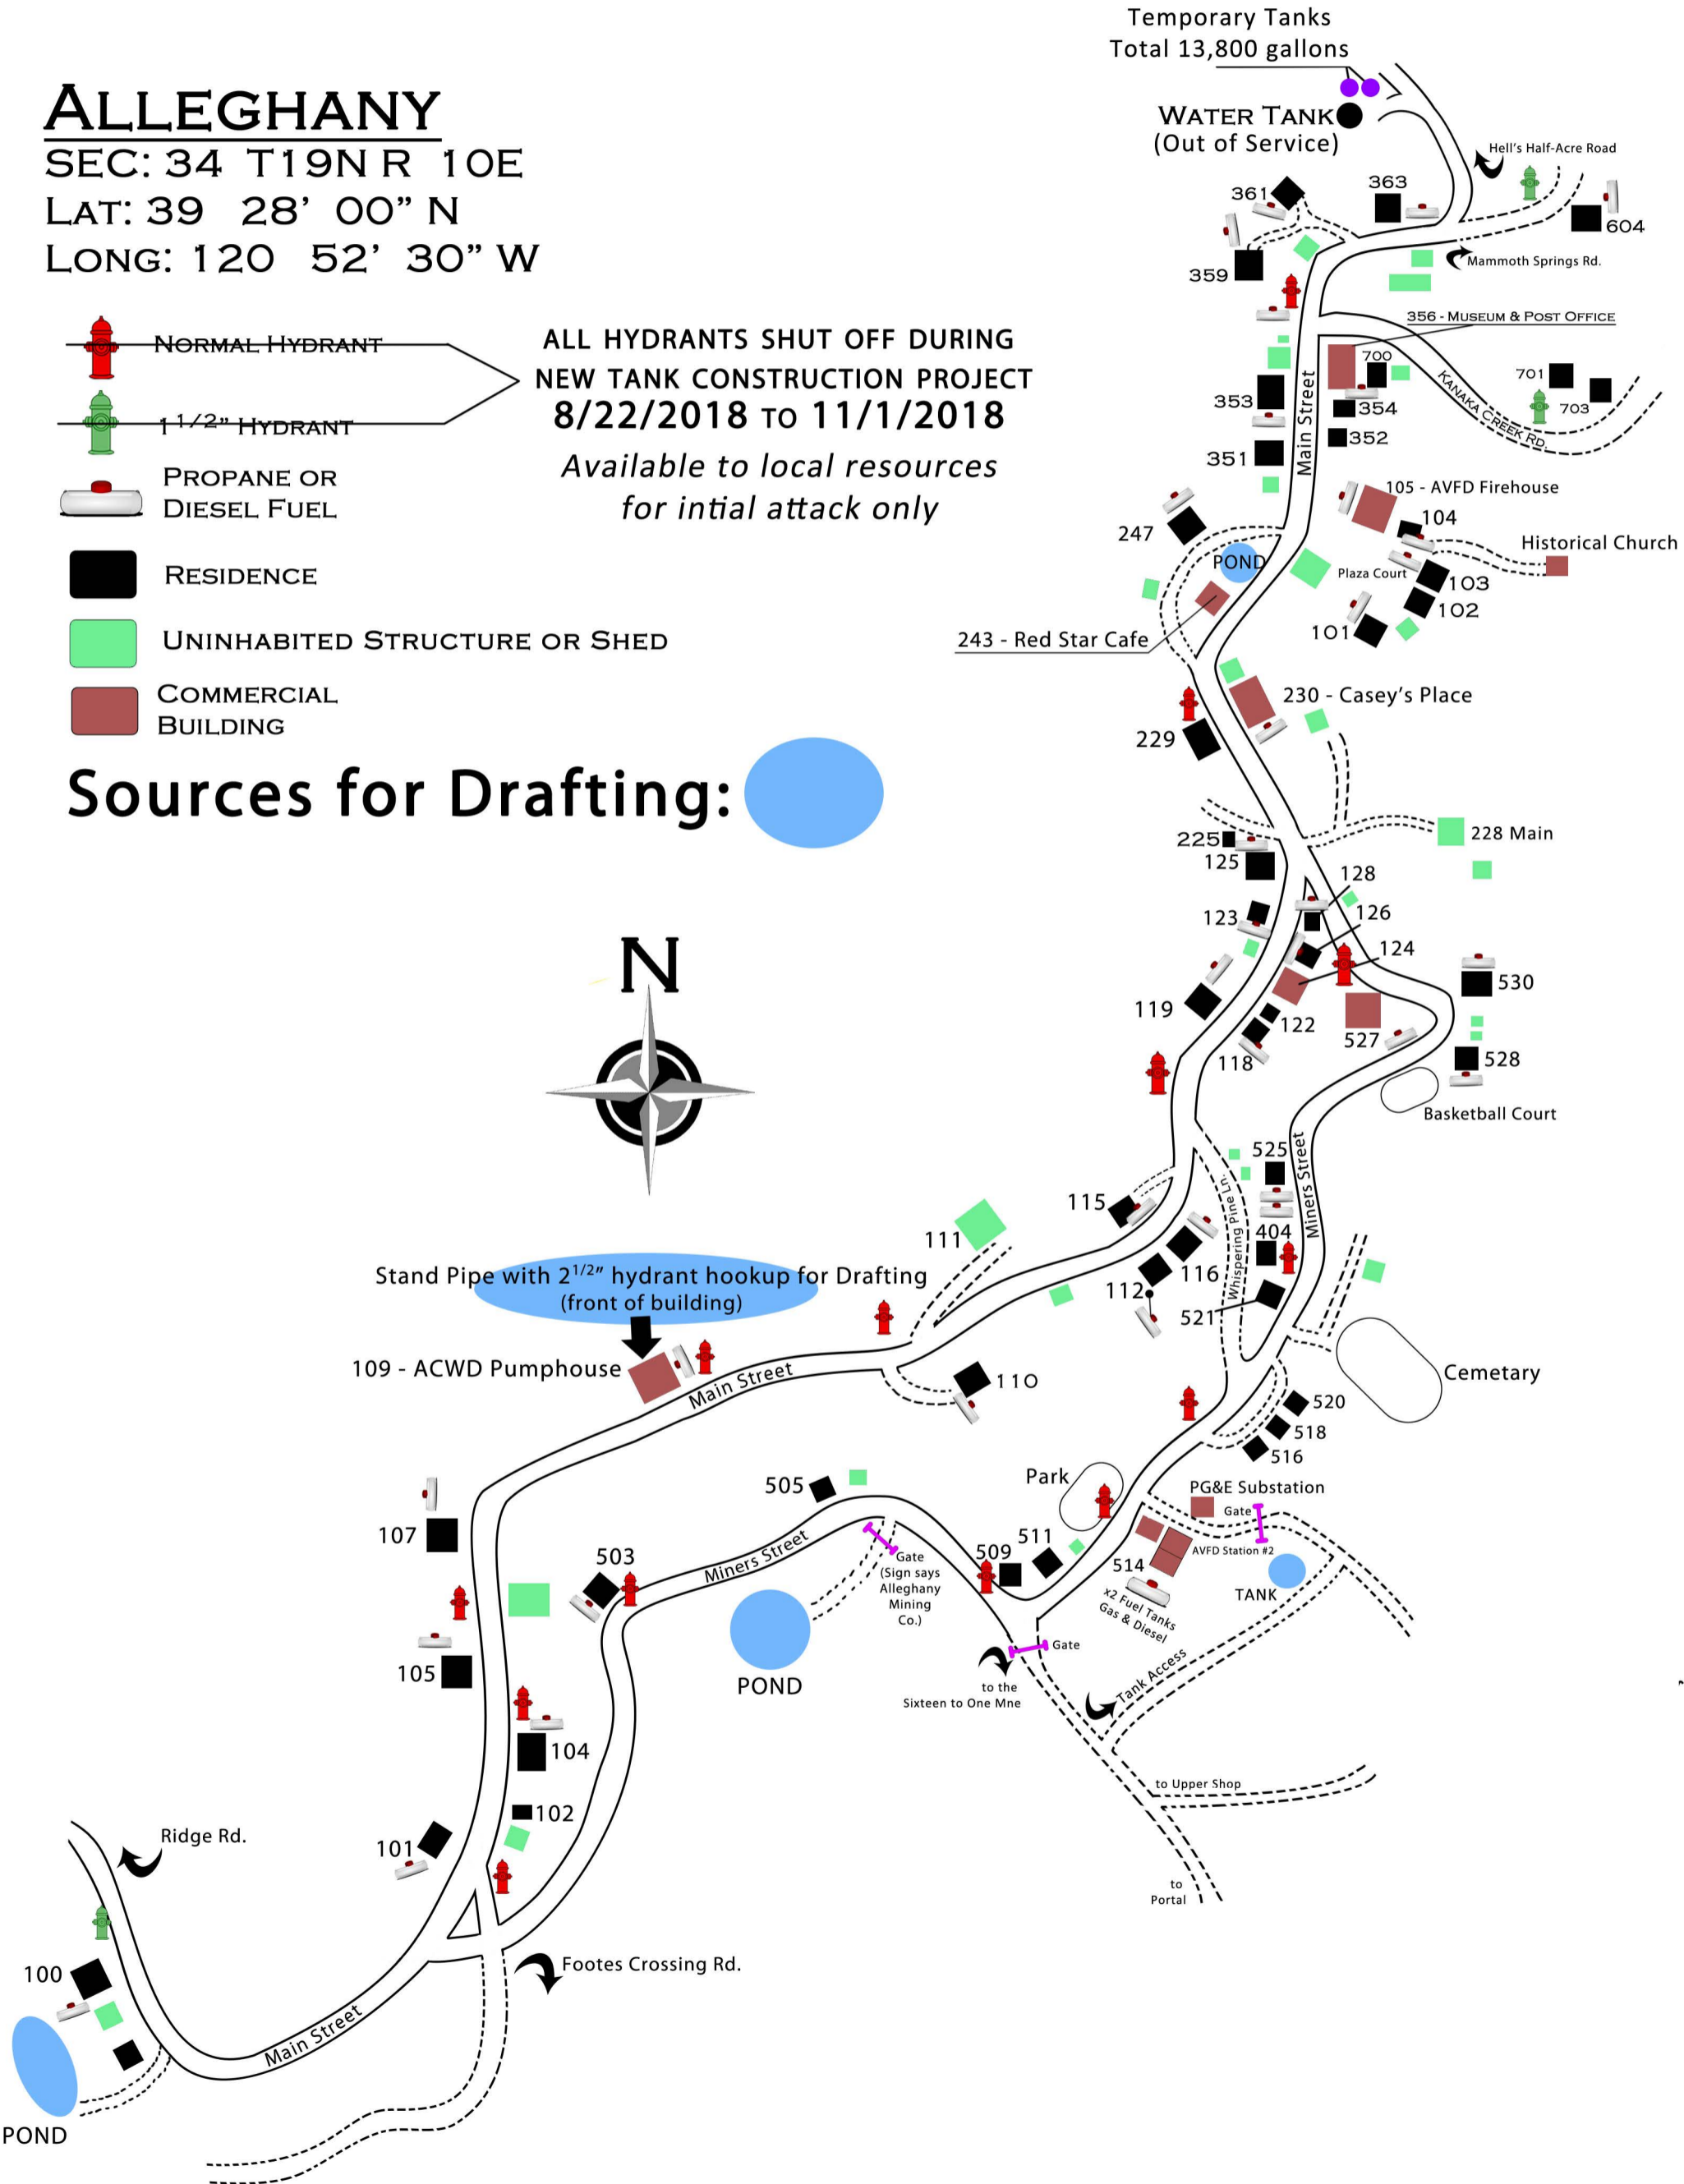

Temporary Tanks
Total 13,800 gallons

Updated
9/19/2018